



## DRINKING WATER SAMPLING REPORT

### **Christa McAuliffe Middle School**

35 South Hope Chapel Road  
Jackson, New Jersey 08527

### **Report Date**

April 29, 2025

### **Partner Project No.**

24-447445.1

### **Prepared for:**

Jackson Township Board of Education  
Jackson, New Jersey 08527



Building  
Science



Environmental  
Consulting



Construction &  
Development



Energy &  
Sustainability



April 29, 2025

Anthony Bruno  
Jackson Township Board of Education  
151 Don Connor Boulevard  
Jackson, New Jersey 08527

Subject: Drinking Water Sampling Report  
Christa McAuliffe Middle School  
35 South Hope Chapel Road  
Jackson, New Jersey 08527  
Partner Project No. 24-447445.1

Dear Anthony Bruno,

Partner Engineering and Science, Inc. (Partner) is pleased to provide the *Drinking Water Sampling* of the abovementioned address (the "Subject Property"). This sampling event was performed in general conformance with the scope and limitations as detailed in our fee proposal. This inspection included a site reconnaissance as well as sampling and analysis. An assessment was made, conclusions stated, and recommendations outlined, as required.

This survey included a site reconnaissance as well as sampling and analysis. An assessment was conducted, conclusions stated, and recommendations outlined, as necessary.

We appreciate the opportunity to provide industrial hygiene services to Jackson Township Board of Education. If you have any questions concerning this report, or if we can assist you in any other matter, please contact me at (908) 497-8904.

Sincerely,

Partner Engineering and Science, Inc.

Dan Bracey, CIH, CSP, CHMM  
Technical Director  
EHS Solutions

## EXECUTIVE SUMMARY

Partner presents our report for this Drinking Water Sampling Report of Christa McAuliffe Middle School located at 35 South Hope Chapel Road, Jackson, New Jersey on March 1, 2025. Samples were collected according to the "New Jersey Department of Education N.J.A.C. 6A:26" requirements for testing of lead in New Jersey Schools and the "USEPA 3Ts for Reducing Lead in Drinking Water in Schools" recommendations, as well as the Safe Drinking Water Act of 1974.

The first sample at each fixture was a "first draw" which was collected directly from the fixture without letting the water run or flush. The second sample was collected after letting the water run (flush) for thirty seconds. This sample evaluates the lead in water from the water purveyor and the pipes outside the building. The samples collected were analyzed by EUROFINS Built Environment Testing, located in Mt. Laurel, New Jersey for analysis of lead content using ASTM Method D3559-15D for lead in drinking water. The action level for lead has been set at 15 parts per billion (ppb). According to the USEPA, given present technology and resources, this level is the lowest level to which water systems can reasonably be required to control this contaminant should it be present in drinking water.

Sample analysis indicated that measured lead concentrations did exceed the USEPA Action Level of 15 ppb for lead at Christa McAuliffe School. Specifically, water from the following outlets had exceedances:

Table 1: USEPA Action Level Exceedances		
Sample Name	Location	Results (ppb)
CM-S-44	Rm 209	55.2

*ppb= parts per billion*

Based on the above referenced sample analytical results, Partner recommends the following actions:

- Remove drinking water outlets of concern from service.
- Sink outlets exceeding the USEPA Action Level should be labelled as "Do Not Drink – Safe for Handwashing Only".
- Conduct an investigation into the drinking water outlet of concern and replace any potential lead-leaching fixtures or equipment, such as fixtures and associated piping, that may be contributing to dissolved lead in drinking water.

## TABLE OF CONTENTS

---

<b>1.0</b>	<b>INTRODUCTION .....</b>	<b>1</b>
1.1	Subject Property Description.....	1
1.2	Purpose and Scope .....	1
<b>2.0</b>	<b>METHODOLOGY .....</b>	<b>2</b>
<b>3.0</b>	<b>ANALYTICAL RESULTS / CONCLUSIONS AND RECOMMENDATIONS .....</b>	<b>3</b>
3.1	Conclusions and Recommendations .....	3
<b>4.0</b>	<b>LIMITING CONDITIONS.....</b>	<b>5</b>
<b>5.0</b>	<b>SIGNATURES OF PROFESSIONALS .....</b>	<b>6</b>

The following Appendices are attached at the end of this report.

### **Appendices**

- Appendix A:** Table 2 – Analytical Results Table  
**Appendix B:** Laboratory Analysis and Chain-of-Custody  
**Appendix C:** Sample Location Diagram

# 1.0 INTRODUCTION

---

## 1.1 Subject Property Description

<b>Address:</b>	35 South Hope Chapel Road in Jackson, NJ
<b>Nature of Use:</b>	School
<b>Walk-Through Inspector:</b>	Hunter Hostage
<b>Walk-Through Date:</b>	January 14, 2025
<b>Sampling Conducted By:</b>	Juan Jimenez & Gianna Sandull
<b>Sampling Date :</b>	March 1, 2025

## 1.2 Purpose and Scope

The purpose of this drinking water sampling event was to sample and analyze drinking water for a determination of lead content for comparison with the USEPA Action Level as defined by the National Primary Drinking Water Regulations (NPDWR - 40 CFR Chapter I, Part 141), in addition to the "New Jersey Department of Education N.J.A.C. 6A:26" requirements for testing of lead in New Jersey Schools and the "USEPA 3Ts for Reducing Lead in Drinking Water in Schools". The NPDW set a Maximum Contaminant Level Goal (MCLG) for each listed contaminant, which identifies a level of that contaminant in drinking water below which there is no known or expected risk to health. MCLGs allow for a margin of safety and are non-enforceable public health goals. The MCLG for lead has been set at zero ppb. Since lead contamination generally occurs from corrosion of onsite lead pipes, or lead-based solder on fittings and fixtures, it cannot be directly detected or removed by the municipal water system. Instead, the USEPA is requiring municipal water systems to control the corrosiveness of their water if the level of lead at the tap exceeds an Action Level.

The action level for lead has been set at 15 parts per billion (ppb). According to the NPDWR Lead and Copper Rule (LCR), given present technology and resources, this level is the lowest level to which water systems can reasonably be required to control this contaminant should it be present in drinking water.

## 2.0 METHODOLOGY

---

Select drinking water samples were collected according to the "New Jersey Department of Education N.J.A.C. 6A:26" requirements for testing of lead in New Jersey Schools and the "USEPA 3Ts for Reducing Lead in Drinking Water in Schools" recommendations, as well as the LCR Monitoring requirements for lead in tap water (40 CFR Part 141, Subpart I, § 141.86(b)).

The first sample at each fixture was a "first draw" which was collected directly from the fixture without letting the water run or flush. The second sample was collected after letting the water run (flush) for thirty seconds. This sample evaluates the lead in water from the water purveyor and the pipes outside the building. Ideally, the water had not been used for the past eight hours prior to sampling and not longer than 48 hours prior to sampling. Partner made a reasonable effort to determine whether the stagnation preconditions were able to be met prior to conducting sampling.

Sample bottles were provided by EUROFINS Built Environment Testing located in Mt. Laurel, New Jersey with an appropriate preservative for lead in drinking water sampling. After collection, sample bottles were labeled with a unique identifier and transferred under chain of custody conditions to EUROFINS Built Environment Testing located in Mt. Laurel, New Jersey for analysis by ASTM Method D3559-15D. The laboratory results and chain of custody are contained in **Appendix B**.

## 3.0 ANALYTICAL RESULTS / CONCLUSIONS AND RECOMMENDATIONS

During the course of this site visit, Partner collected water samples at 54 locations. Partner did not attempt to disassemble mechanical equipment, open plumbing pipe chases, or assess materials within wall voids.

Sample names and their respective locations were updated from the 2021 sampling event based on relevant known plumbing information as provided by Christa McAuliffe Middle School and the site guide.

Partner attempted to collect samples from the following outlets; however, based upon the condition of the outlet and recommendations from the site guide, a sample could not be collected at the following locations:

- CM-WF-07
- CM-WF-12
- CM-WF-34
- CM-WF-42
- CM-WF-11
- CM-WF-31
- CM-WF-41
- CM-WF-58

A total of 108 drinking water samples were collected from Christa McAuliffe Middle School on March 1, 2025. A total of 55 samples were analyzed. Table 1 lists the samples that exceeded the USEPA Action Level. The analytical results for all samples collected are listed in **Table 2** in **Appendix A**. Sample locations are depicted on the diagram included in **Appendix C**.

Table 1: USEPA Action Level Exceedances		
Sample Name	Location	Results (ppb)
CM-S-44	Rm 209	55.2

*ppb= parts per billion*

### 3.1 Conclusions and Recommendations

Based on the observations onsite, the noted limitations and the analytical results, Partner has the following recommendations:

- Remove drinking water outlets of concern from service.
- Sink outlets exceeding the USEPA Action Level should be labelled as "Do Not Drink – Safe for Handwashing Only".
- Conduct an investigation into the drinking water outlet of concern and replace any potential lead-leaching fixtures or equipment, such as fixtures and associated piping, that may be contributing to dissolved lead in drinking water.
- Additional control technologies may be utilized to reduce lead content in drinking water, including, but not limited to onsite water treatment and filtration. All response actions should be conducted in according with industry, local, state and federal guidelines and/or requirements.

In the event the remedial action involves replacing the fixture/associated piping or installing a new fixture, Christa McAuliffe School should conduct sampling for lead in drinking water to ensure lead levels are below the action level prior to opening up the fixture for use. Additionally, sampling of all drinking water outlets must be conducted every third school year beginning with the 2021-2022 school year.

Flushing involves opening suspect taps every morning before the facility opens and letting the water run to remove water that has been standing in the interior pipes and/or the outlets. All flushing should be recorded in a log submitted daily to the head of maintenance/facilities. The faucet should be opened and the water should run for 30 seconds to one minute, or until cold.

A filtration device, or point-of-use (POU) device can be relatively inexpensive (\$65 to \$250) or expensive (ranging from \$250 to \$500), their effectiveness varies, and they may be vulnerable to vandalism. They also require a maintenance program for regular upkeep to ensure effectiveness. Cartridge filter units need to be replaced periodically to remain effective. NSF International, an independent, third-party certification organization, has a testing program to evaluate the performance of POU devices for lead removal (NSF Standard 53). Before purchasing any device, ask the manufacturer for proof of NSF approval and the Performance Data Sheet, or check by visiting the NSF Web site at:  
[http://www.nsf.org/business/search\\_listings/index/asp](http://www.nsf.org/business/search_listings/index/asp)



## 4.0 LIMITING CONDITIONS

---

No warranties expressed or implied, are made by Partner or its subcontractor, EUROFINS Built Environment Testing, or their employees as to the use of any information, apparatus, product, or process disclosed in this report. Every reasonable effort has been made to assure correctness. This survey is limited by the scope discussed by the client. It was prepared for the sole use and benefit of the Client. Neither this report nor any of the information contained herein shall be used or relied upon for any purpose by any persons or entities other than the Client.

Property and climate conditions, as well as local, state, and federal regulations, can change significantly over time. Therefore, the recommendations and conclusions presented as a result of this study apply strictly to the environmental regulations and property conditions existing at the time the study was performed. Available information has been analyzed using currently accepted industry assessment techniques and it is believed that the inferences made are reasonably representative of the property. Partner and its subcontractor EUROFINS Built Environment Testing and their employees/representatives bear no responsibility for the actual condition of the structure or safety of this site pertaining to water quality contamination regardless of the actions taken by the inspection team or the client. Partner makes no warranty, expressed or implied, except that the services have been performed in accordance with generally accepted assessment practices applicable at the time and location of the study.

## 5.0 SIGNATURES OF PROFESSIONALS

---

Partner has performed lead-in-drinking water sampling on the property at 35 South Hope Chapel Road, Jackson, New Jersey in general conformance with the scope and limitations of the protocol and the limitations stated earlier in this report. Exceptions to or deletions from this protocol are discussed earlier in this report.

Prepared By:

**Partner Engineering and Science, Inc.**



Juan Jimenez  
Industrial Hygienist

Reviewed by:



Daniel Bracey, CIH, CSP, CHMM  
Technical Director

## APPENDIX A: TABLE 2 – ANALYTICAL RESULTS TABLE

---

Table 2: Analytical Results		
Sample Name	Location	Results (ppb)
CM-S-01	Mechanical Room	3.20
CM-WF-02	Adjacent Rm 125	1.90
CM-WF-03	Adjacent Rm 125	<1.00
CM-WF-04	Adjacent Rm 125	<1.00
CM-S-06	Faculty Rm	<1.00
CM-BF-14	Across Rm 111	<1.00
CM- WF-08	Across Rm 115	<1.00
CM-WF-09	Across Rm 115	1.20
CM-WF-10	Across Rm 115	1.60
CM-WF-13	Across Rm 111	2.00
CM-WF-14	Across Rm 111	<1.00
CM-WF-15	Across Rm 111	<1.00
CM-WF-16	Across Rm 111	2.00
CM-WF-17	Across Rm 111	<1.00
CM-WF-18	Across Rm 111	<1.00
CM-WF-19	Adjacent Rm 129	<1.00
CM-BF-20	Adjacent arm 129	<1.00
CM-WF-21	Adjacent ram 129	<1.00
CM-S-22	Room 127	<1.00
CM-S-23	Room 127	<1.00
CM-S-24	Room 127	1.50
CM-S-25	Room 127	1.80
CM-S-26	Room 127	<1.00
CM-S-27	Room 127	<1.00
CM-S-28	Room 127	<1.00
CM-WF-29	Adjacent Nurse	<1.00
CM-BF-30	Adjacent Nurse	<1.00
CM-S-32	Nurse Office	<1.00
CM-S-33	Between Rm 214 and 215	<1.00
CM-WF-35	Across Rm 214	<1.00

Table 2: Analytical Results		
Sample Name	Location	Results (ppb)
CM-WF-36	Across Rm 214	<1.00
CM-WF-37	Across Rm 214-A	<1.00
CM-BF-38	Across Rm 214-A	<1.00
CM-WF-40	Across 209	2.10
CM-S-39	Rm 214-A	<1.00
CM-WF-43	Across Rm 209	<1.00
<b>CM-S-44</b>	<b>Rm 209</b>	<b>55.2 (2.50)</b>
CM-S-47	Faculty Lounge	<1.00
CM-WF-48	Cafeteria Hall	1.80
CM-WF-49	Cafeteria Hall	<1.00
CM-BF-50	Cafeteria Hall	<1.00
CM-WF-51	Cafeteria Hall	1.00
CM-WF-52	Cafeteria Hall	<1.00
CM-S-53	Cafeteria	<1.00
CM-S-54	Cafeteria	2.60
CM-S-55	Cafeteria	1.70
CM-S-56	Cafeteria	2.80
CM-IM-57	Cafeteria	<1.00
CM-WF-59	Gym	<1.00
CM-WF-60	Gym	<1.00
CM-WF-61	Gym	1.20
CM-WF-62	Gym	1.40
CM-WF-63	Gym	1.20
CM-BF-05	Adjacent Rm 125	<1.00

1 ppb = 1 ug/L

**Bold** = Exceedances above USEPA Action Level 15 ppb

Parenthesis ( ) = Flush Samples

## **APPENDIX B: LABORATORY ANALYSIS AND CHAIN-OF-CUSTODY**

---



CERTIFICATE OF ANALYSIS

Client: Partner Engineering and Science  
929 Asbury Ave  
Asbury Park NJ 07712


Report Date: 3/18/2025  
Report No.: 710484 - Lead Water  
Project: Jackson LIDW 2024; Christa McAuliffe  
Middle  
Project No.: 24-447445.1


Client: PAR929

LEAD WATER SAMPLE ANALYSIS SUMMARY

Lab No.:7826613 Client No.:CM-S-01	Location:Mechanical Room * Sample acidified to pH <2.	Result(ppb):3.20
Lab No.:7826614 Client No.:CM-S-01-F	Location:Mechanical Room * Sample acidified to pH <2.	Result(ppb):Sample Not Analyzed
Lab No.:7826615 Client No.:CM-WF-02	Location:Adjacent Rm 125 * Sample acidified to pH <2.	Result(ppb):1.90
Lab No.:7826616 Client No.:CM-WF-02-F	Location:Adjacent Rm 125 * Sample acidified to pH <2.	Result(ppb):Sample Not Analyzed
Lab No.:7826617 Client No.:CM-WF-03	Location:Adjacent Rm 125 * Sample acidified to pH <2.	Result(ppb):<1.00
Lab No.:7826618 Client No.:CM-WF-03-F	Location:Adjacent Rm 125 * Sample acidified to pH <2.	Result(ppb):Sample Not Analyzed
Lab No.:7826619 Client No.:CM-WF-04	Location:Adjacent Rm 125 * Sample acidified to pH <2.	Result(ppb):<1.00
Lab No.:7826620 Client No.:CM-WF-04-F	Location:Adjacent Rm 125 * Sample acidified to pH <2.	Result(ppb):Sample Not Analyzed
Lab No.:7826621 Client No.:CM-S-06	Location:Faculty Rm * Sample acidified to pH <2.	Result(ppb):<1.00
Lab No.:7826622 Client No.:CM-S-06-F	Location:Faculty Rm * Sample acidified to pH <2.	Result(ppb):Sample Not Analyzed

Please refer to the Appendix of this report for further information regarding your analysis.

Date Received: 3/4/2025  
Date Analyzed: 03/18/2025  
Signature:   
Analyst: Chad Shaffer

Approved By:   
Frank E. Ehrenfeld, III  
Laboratory Director

# CERTIFICATE OF ANALYSIS

Client: Partner Engineering and Science  
929 Asbury Ave  
Asbury Park NJ 07712


Report Date: 3/18/2025  
Report No.: 710484 - Lead Water  
Project: Jackson LIDW 2024; Christa McAuliffe  
Middle  
Project No.: 24-447445.1


Client: PAR929

## LEAD WATER SAMPLE ANALYSIS SUMMARY

Lab No.:7826623 Client No.:CM-BE-14	Location:Across Rm 111 * Sample acidified to pH <2.	Result(ppb):<1.00
Lab No.:7826624 Client No.:CM-BE-14-F	Location:Across Rm 111 * Sample acidified to pH <2.	Result(ppb):Sample Not Analyzed
Lab No.:7826625 Client No.:CM- WF-08	Location:Across Rm 115 * Sample acidified to pH <2.	Result(ppb):<1.00
Lab No.:7826626 Client No.:CM- WF-08-F	Location:Across Rm 115 * Sample acidified to pH <2.	Result(ppb):Sample Not Analyzed
Lab No.:7826627 Client No.:CM-WF-09	Location:Across Rm 115 * Sample acidified to pH <2.	Result(ppb):1.20
Lab No.:7826628 Client No.:CM-WF-09-F	Location:Across Rm 115 * Sample acidified to pH <2.	Result(ppb):Sample Not Analyzed
Lab No.:7826629 Client No.:CM-WF-10	Location:Across Rm 115 * Sample acidified to pH <2.	Result(ppb):1.60
Lab No.:7826630 Client No.:CM-WF-10-F	Location:Across Rm 115 * Sample acidified to pH <2.	Result(ppb):Sample Not Analyzed
Lab No.:7826631 Client No.:CM-WF-13	Location:Across Rm 111 * Sample acidified to pH <2.	Result(ppb):2.00
Lab No.:7826632 Client No.:CM-WF-13-F	Location:Across Rm 111 * Sample acidified to pH <2.	Result(ppb):Sample Not Analyzed

Please refer to the Appendix of this report for further information regarding your analysis.

Date Received: 3/4/2025  
Date Analyzed: 03/18/2025  
Signature:   
Analyst: Chad Shaffer

Approved By:   
Frank E. Ehrenfeld, III  
Laboratory Director





CERTIFICATE OF ANALYSIS

Client: Partner Engineering and Science  
929 Asbury Ave  
Asbury Park NJ 07712


Report Date: 3/18/2025  
Report No.: 710484 - Lead Water  
Project: Jackson LIDW 2024; Christa McAuliffe  
Middle  
Project No.: 24-447445.1


Client: PAR929

LEAD WATER SAMPLE ANALYSIS SUMMARY

Lab No.:7826633 Client No.:CM-WF-14	Location:Across Rm 111 * Sample acidified to pH <2.	Result(ppb):<1.00
Lab No.:7826634 Client No.:CM-WF-14-F	Location:Across Rm 111 * Sample acidified to pH <2.	Result(ppb):Sample Not Analyzed
Lab No.:7826635 Client No.:CM-WF-15	Location:Across Rm 111 * Sample acidified to pH <2.	Result(ppb):<1.00
Lab No.:7826636 Client No.:CM-WF-15-F	Location:Across Rm 111 * Sample acidified to pH <2.	Result(ppb):Sample Not Analyzed
Lab No.:7826637 Client No.:CM-WF-16	Location:Across Rm 111 * Sample acidified to pH <2.	Result(ppb):2.00
Lab No.:7826638 Client No.:CM-WF-16-F	Location:Across Rm 111 * Sample acidified to pH <2.	Result(ppb):Sample Not Analyzed
Lab No.:7826639 Client No.:CM-WF-17	Location:Across Rm 111 * Sample acidified to pH <2.	Result(ppb):<1.00
Lab No.:7826640 Client No.:CM-WF-17-F	Location:Across Rm 111 * Sample acidified to pH <2.	Result(ppb):Sample Not Analyzed
Lab No.:7826641 Client No.:CM-WF-18	Location:Across Rm 111 * Sample acidified to pH <2.	Result(ppb):<1.00
Lab No.:7826642 Client No.:CM-WF-18-F	Location:Across Rm 111 * Sample acidified to pH <2.	Result(ppb):Sample Not Analyzed

Please refer to the Appendix of this report for further information regarding your analysis.

Date Received: 3/4/2025  
Date Analyzed: 03/18/2025  
Signature:   
Analyst: Chad Shaffer

Approved By:   
Frank E. Ehrenfeld, III  
Laboratory Director

CERTIFICATE OF ANALYSIS

Client: Partner Engineering and Science  
929 Asbury Ave  
Asbury Park NJ 07712


Report Date: 3/18/2025  
Report No.: 710484 - Lead Water  
Project: Jackson LIDW 2024; Christa McAuliffe  
Middle  
Project No.: 24-447445.1


Client: PAR929

LEAD WATER SAMPLE ANALYSIS SUMMARY

Lab No.:7826643 Client No.:CM-WF-19	Location:Adjacent Rm 129 * Sample acidified to pH <2.	Result(ppb):<1.00
Lab No.:7826644 Client No.:CM-WF-19-F	Location:Adjacent Rm 129 * Sample acidified to pH <2.	Result(ppb):Sample Not Analyzed
Lab No.:7826645 Client No.:CM-BF-20	Location:Adjacent Rm 129 * Sample acidified to pH <2.	Result(ppb):<1.00
Lab No.:7826646 Client No.:CM-BF-20-F	Location:Adjacent Rm 129 * Sample acidified to pH <2.	Result(ppb):Sample Not Analyzed
Lab No.:7826647 Client No.:CM-WF-21	Location:Adjacent Rm 129 * Sample acidified to pH <2.	Result(ppb):<1.00
Lab No.:7826648 Client No.:CM-WF-21-F	Location:Adjacent Rm 129 * Sample acidified to pH <2.	Result(ppb):Sample Not Analyzed
Lab No.:7826649 Client No.:CM-S-22	Location:Room 127 * Sample acidified to pH <2.	Result(ppb):<1.00
Lab No.:7826650 Client No.:CM-S-22-F	Location:Room 127 * Sample acidified to pH <2.	Result(ppb):Sample Not Analyzed
Lab No.:7826651 Client No.:CM-S-23	Location:Room 127 * Sample acidified to pH <2.	Result(ppb):<1.00
Lab No.:7826652 Client No.:CM-S-23-F	Location:Room 127 * Sample acidified to pH <2.	Result(ppb):Sample Not Analyzed

Please refer to the Appendix of this report for further information regarding your analysis.

Date Received: 3/4/2025  
Date Analyzed: 03/18/2025  
Signature:   
Analyst: Chad Shaffer

Approved By:   
Frank E. Ehrenfeld, III  
Laboratory Director



CERTIFICATE OF ANALYSIS

Client: Partner Engineering and Science  
929 Asbury Ave  
Asbury Park NJ 07712


Report Date: 3/18/2025  
Report No.: 710484 - Lead Water  
Project: Jackson LIDW 2024; Christa McAuliffe  
Middle  
Project No.: 24-447445.1


Client: PAR929

LEAD WATER SAMPLE ANALYSIS SUMMARY

Lab No.:7826653 Client No.:CM-S-24	Location:Room 127 * Sample acidified to pH <2.	Result(ppb):1.50
Lab No.:7826654 Client No.:CM-S-24-F	Location:Room 127 * Sample acidified to pH <2.	Result(ppb):Sample Not Analyzed
Lab No.:7826655 Client No.:CM-S-25	Location:Room 127 * Sample acidified to pH <2.	Result(ppb):1.80
Lab No.:7826656 Client No.:CM-S-25-F	Location:Room 127 * Sample acidified to pH <2.	Result(ppb):Sample Not Analyzed
Lab No.:7826657 Client No.:CM-S-26	Location:Room 127 * Sample acidified to pH <2.	Result(ppb):<1.00
Lab No.:7826658 Client No.:CM-S-26-F	Location:Room 127 * Sample acidified to pH <2.	Result(ppb):Sample Not Analyzed
Lab No.:7826659 Client No.:CM-S-27	Location:Room 127 * Sample acidified to pH <2.	Result(ppb):<1.00
Lab No.:7826660 Client No.:CM-S-27-F	Location:Room 127 * Sample acidified to pH <2.	Result(ppb):Sample Not Analyzed
Lab No.:7826661 Client No.:CM-S-28	Location:Room 127 * Sample acidified to pH <2.	Result(ppb):<1.00
Lab No.:7826662 Client No.:CM-S-28-F	Location:Room 127 * Sample acidified to pH <2.	Result(ppb):Sample Not Analyzed

Please refer to the Appendix of this report for further information regarding your analysis.

Date Received: 3/4/2025  
Date Analyzed: 03/18/2025  
Signature:   
Analyst: Chad Shaffer

Approved By:   
Frank E. Ehrenfeld, III  
Laboratory Director



CERTIFICATE OF ANALYSIS

Client: Partner Engineering and Science  
929 Asbury Ave  
Asbury Park NJ 07712


Report Date: 3/18/2025  
Report No.: 710484 - Lead Water  
Project: Jackson LIDW 2024; Christa McAuliffe  
Middle  
Project No.: 24-447445.1


Client: PAR929

LEAD WATER SAMPLE ANALYSIS SUMMARY

Lab No.: 7826663 Client No.: CM-WF-29	Location: Adjacent Nurse * Sample acidified to pH <2.	Result(ppb): <1.00
Lab No.: 7826664 Client No.: CM-WF-29-F	Location: Adjacent Nurse * Sample acidified to pH <2.	Result(ppb): Sample Not Analyzed
Lab No.: 7826665 Client No.: CM-BF-30	Location: Adjacent Nurse * Sample acidified to pH <2.	Result(ppb): <1.00
Lab No.: 7826666 Client No.: CM-BF-30-F	Location: Adjacent Nurse * Sample acidified to pH <2.	Result(ppb): Sample Not Analyzed
Lab No.: 7826667 Client No.: CM-S-32	Location: Nurse Office * Sample acidified to pH <2.	Result(ppb): <1.00
Lab No.: 7826668 Client No.: CM-S-32-F	Location: Nurse Office * Sample acidified to pH <2.	Result(ppb): Sample Not Analyzed
Lab No.: 7826669 Client No.: CM-S-33	Location: Between Rm 214 and 215 * Sample acidified to pH <2.	Result(ppb): <1.00
Lab No.: 7826670 Client No.: CM-S-33-F	Location: Between Rm 214 and 215 * Sample acidified to pH <2.	Result(ppb): Sample Not Analyzed
Lab No.: 7826671 Client No.: CM-WF-35	Location: Across Rm 214 * Sample acidified to pH <2.	Result(ppb): <1.00
Lab No.: 7826672 Client No.: CM-WF-35-F	Location: Across Rm 214 * Sample acidified to pH <2.	Result(ppb): Sample Not Analyzed

Please refer to the Appendix of this report for further information regarding your analysis.

Date Received: 3/4/2025  
Date Analyzed: 03/18/2025  
Signature:   
Analyst: Chad Shaffer

Approved By:   
Frank E. Ehrenfeld, III  
Laboratory Director



CERTIFICATE OF ANALYSIS

Client: Partner Engineering and Science  
929 Asbury Ave  
Asbury Park NJ 07712


Report Date: 3/18/2025  
Report No.: 710484 - Lead Water  
Project: Jackson LIDW 2024; Christa McAuliffe  
Middle  
Project No.: 24-447445.1


Client: PAR929

LEAD WATER SAMPLE ANALYSIS SUMMARY

Lab No.: 7826673 Client No.: CM-WF-36	Location: Across Rm 214 * Sample acidified to pH <2.	Result(ppb): <1.00
Lab No.: 7826674 Client No.: CM-WF-36-F	Location: Across Rm 214 * Sample acidified to pH <2.	Result(ppb): Sample Not Analyzed
Lab No.: 7826675 Client No.: CM-WF-37	Location: Across Rm 214-A * Sample acidified to pH <2.	Result(ppb): <1.00
Lab No.: 7826676 Client No.: CM-WF-37-F	Location: Across Rm 214-A * Sample acidified to pH <2.	Result(ppb): Sample Not Analyzed
Lab No.: 7826677 Client No.: CM-BF-38	Location: Across Rm 214-A * Sample acidified to pH <2.	Result(ppb): <1.00
Lab No.: 7826678 Client No.: CM-BF-38-F	Location: Across Rm 214-A * Sample acidified to pH <2.	Result(ppb): Sample Not Analyzed
Lab No.: 7826679 Client No.: CM-WF-40	Location: Across 209 * Sample acidified to pH <2.	Result(ppb): 2.10
Lab No.: 7826680 Client No.: CM-WF-40-F	Location: Across 209 * Sample acidified to pH <2.	Result(ppb): Sample Not Analyzed
Lab No.: 7826681 Client No.: CM-S-39	Location: Rm 214-A * Sample acidified to pH <2.	Result(ppb): <1.00
Lab No.: 7826682 Client No.: CM-S-39-F	Location: Rm 214-A * Sample acidified to pH <2.	Result(ppb): Sample Not Analyzed

Please refer to the Appendix of this report for further information regarding your analysis.

Date Received: 3/4/2025  
Date Analyzed: 03/18/2025  
Signature:   
Analyst: Chad Shaffer

Approved By:   
Frank E. Ehrenfeld, III  
Laboratory Director

# CERTIFICATE OF ANALYSIS

Client: Partner Engineering and Science  
929 Asbury Ave  
Asbury Park NJ 07712


Report Date: 3/18/2025  
Report No.: 710484 - Lead Water  
Project: Jackson LIDW 2024; Christa McAuliffe  
Middle  
Project No.: 24-447445.1


Client: PAR929

## LEAD WATER SAMPLE ANALYSIS SUMMARY

<b>Lab No.:</b> 7826683 <b>Client No.:</b> CM-WF-43	<b>Location:</b> Across Rm 209 * Sample acidified to pH <2.	<b>Result(ppb):</b> <1.00
<b>Lab No.:</b> 7826684 <b>Client No.:</b> CM-WF-43-F	<b>Location:</b> Across Rm 209 * Sample acidified to pH <2.	<b>Result(ppb):</b> Sample Not Analyzed
<b>Lab No.:</b> 7826685 <b>Client No.:</b> CM-S-44	<b>Location:</b> Rm 209 * Sample acidified to pH <2.	<b>Result(ppb):</b> 55.2
<b>Lab No.:</b> 7826686 <b>Client No.:</b> CM-S-44-F	<b>Location:</b> Rm 209 * Sample acidified to pH <2.	<b>Result(ppb):</b> 2.50
<b>Lab No.:</b> 7826687 <b>Client No.:</b> CM-S-47	<b>Location:</b> Faculty Lounge * Sample acidified to pH <2.	<b>Result(ppb):</b> <1.00
<b>Lab No.:</b> 7826688 <b>Client No.:</b> CM-S-47-F	<b>Location:</b> Faculty Lounge * Sample acidified to pH <2.	<b>Result(ppb):</b> Sample Not Analyzed
<b>Lab No.:</b> 7826689 <b>Client No.:</b> CM-WF-48	<b>Location:</b> Cafeteria Hall * Sample acidified to pH <2.	<b>Result(ppb):</b> 1.80
<b>Lab No.:</b> 7826690 <b>Client No.:</b> CM-WF-48-F	<b>Location:</b> Cafeteria Hall * Sample acidified to pH <2.	<b>Result(ppb):</b> Sample Not Analyzed
<b>Lab No.:</b> 7826691 <b>Client No.:</b> CM-WF-49	<b>Location:</b> Cafeteria Hall * Sample acidified to pH <2.	<b>Result(ppb):</b> <1.00
<b>Lab No.:</b> 7826692 <b>Client No.:</b> CM-WF-49-F	<b>Location:</b> Cafeteria Hall * Sample acidified to pH <2.	<b>Result(ppb):</b> Sample Not Analyzed

Please refer to the Appendix of this report for further information regarding your analysis.

Date Received: 3/4/2025  
Date Analyzed: 03/18/2025  
Signature:   
Analyst: Chad Shaffer

Approved By:   
Frank E. Ehrenfeld, III  
Laboratory Director



CERTIFICATE OF ANALYSIS

Client: Partner Engineering and Science  
929 Asbury Ave  
Asbury Park NJ 07712


Report Date: 3/18/2025  
Report No.: 710484 - Lead Water  
Project: Jackson LIDW 2024; Christa McAuliffe  
Middle  
Project No.: 24-447445.1


Client: PAR929

LEAD WATER SAMPLE ANALYSIS SUMMARY

Lab No.:7826693 Client No.:CM-BF-50	Location:Cafeteria Hall * Sample acidified to pH <2.	Result(ppb):<1.00
Lab No.:7826694 Client No.:CM-BF-50-F	Location:Cafeteria Hall * Sample acidified to pH <2.	Result(ppb):Sample Not Analyzed
Lab No.:7826695 Client No.:CM-WF-51	Location:Cafeteria Hall * Sample acidified to pH <2.	Result(ppb):1.00
Lab No.:7826696 Client No.:CM-WF-51-F	Location:Cafeteria Hall * Sample acidified to pH <2.	Result(ppb):Sample Not Analyzed
Lab No.:7826697 Client No.:CM-WF-52	Location:Cafeteria Hall * Sample acidified to pH <2.	Result(ppb):<1.00
Lab No.:7826698 Client No.:CM-WF-52-F	Location:Cafeteria Hall * Sample acidified to pH <2.	Result(ppb):Sample Not Analyzed
Lab No.:7826699 Client No.:CM-S-53	Location:Cafeteria * Sample acidified to pH <2.	Result(ppb):<1.00
Lab No.:7826700 Client No.:CM-S-53-F	Location:Cafeteria * Sample acidified to pH <2.	Result(ppb):Sample Not Analyzed
Lab No.:7826701 Client No.:CM-S-54	Location:Cafeteria * Sample acidified to pH <2.	Result(ppb):2.60
Lab No.:7826702 Client No.:CM-S-54-F	Location:Cafeteria * Sample acidified to pH <2.	Result(ppb):Sample Not Analyzed

Please refer to the Appendix of this report for further information regarding your analysis.

Date Received: 3/4/2025  
Date Analyzed: 03/18/2025  
Signature:   
Analyst: Chad Shaffer

Approved By:   
Frank E. Ehrenfeld, III  
Laboratory Director



### CERTIFICATE OF ANALYSIS

Client: Partner Engineering and Science  
929 Asbury Ave  
Asbury Park NJ 07712


Report Date: 3/18/2025  
Report No.: 710484 - Lead Water  
Project: Jackson LIDW 2024; Christa McAuliffe  
Middle  
Project No.: 24-447445.1


Client: PAR929

### LEAD WATER SAMPLE ANALYSIS SUMMARY

Lab No.: 7826703 Client No.: CM-S-55	Location: Cafeteria * Sample acidified to pH <2.	Result(ppb): 1.70
Lab No.: 7826704 Client No.: CM-S-55-F	Location: Cafeteria * Sample acidified to pH <2.	Result(ppb): Sample Not Analyzed
Lab No.: 7826705 Client No.: CM-S-56	Location: Cafeteria * Sample acidified to pH <2.	Result(ppb): 2.80
Lab No.: 7826706 Client No.: CM-S-56-F	Location: Cafeteria * Sample acidified to pH <2.	Result(ppb): Sample Not Analyzed
Lab No.: 7826707 Client No.: CM-IM-57	Location: Cafeteria * Sample acidified to pH <2.	Result(ppb): <1.00
Lab No.: 7826708 Client No.: CM-IM-57-F	Location: Cafeteria * Sample acidified to pH <2.	Result(ppb): Sample Not Analyzed
Lab No.: 7826709 Client No.: CM-WF-59	Location: Gym * Sample acidified to pH <2.	Result(ppb): <1.00
Lab No.: 7826710 Client No.: CM-WF-59-F	Location: Gym * Sample acidified to pH <2.	Result(ppb): Sample Not Analyzed
Lab No.: 7826711 Client No.: CM-WF-60	Location: Gym * Sample acidified to pH <2.	Result(ppb): <1.00
Lab No.: 7826712 Client No.: CM-WF-60-F	Location: Gym * Sample acidified to pH <2.	Result(ppb): Sample Not Analyzed

Please refer to the Appendix of this report for further information regarding your analysis.

Date Received: 3/4/2025  
Date Analyzed: 03/18/2025  
Signature:   
Analyst: Chad Shaffer

Approved By:   
Frank E. Ehrenfeld, III  
Laboratory Director





CERTIFICATE OF ANALYSIS

Client: Partner Engineering and Science  
929 Asbury Ave  
Asbury Park NJ 07712


Report Date: 3/18/2025  
Report No.: 710484 - Lead Water  
Project: Jackson LIDW 2024; Christa McAuliffe  
Middle  
Project No.: 24-447445.1


Client: PAR929

LEAD WATER SAMPLE ANALYSIS SUMMARY

Lab No.:7826713 Client No.:CM-WF-61	Location:Gym * Sample acidified to pH <2.	Result(ppb):1.20
Lab No.:7826714 Client No.:CM-WF-61-F	Location:Gym * Sample acidified to pH <2.	Result(ppb):Sample Not Analyzed
Lab No.:7826715 Client No.:CM-WF-62	Location:Gym * Sample acidified to pH <2.	Result(ppb):1.40
Lab No.:7826716 Client No.:CM-WF-62-F	Location:Gym * Sample acidified to pH <2.	Result(ppb):Sample Not Analyzed
Lab No.:7826717 Client No.:CM-WF-63	Location:Gym * Sample acidified to pH <2.	Result(ppb):1.20
Lab No.:7826718 Client No.:CM-WF-63-F	Location:Gym * Sample acidified to pH <2.	Result(ppb):Sample Not Analyzed
Lab No.:7826719 Client No.:CM-BF-05	Location:Adjacent Rm 125 * Sample acidified to pH <2.	Result(ppb):<1.00
Lab No.:7826720 Client No.:CM-BF-05-F	Location:Adjacent Rm 125 * Sample acidified to pH <2.	Result(ppb):Sample Not Analyzed

Please refer to the Appendix of this report for further information regarding your analysis.

Date Received: 3/4/2025  
Date Analyzed: 03/18/2025  
Signature:   
Analyst: Chad Shaffer

Approved By:   
Frank E. Ehrenfeld, III  
Laboratory Director

## CERTIFICATE OF ANALYSIS

Client: Partner Engineering and Science  
929 Asbury Ave  
Asbury Park NJ 07712

Report Date: 3/18/2025  
Report No.: 710484 - Lead Water  
Project: Jackson LIDW 2024; Christa McAuliffe  
Middle  
Project No.: 24-447445.1

Client: PAR929

## Appendix to Analytical Report:

### Customer Contact:

Analysis: AAS-GF - ASTM D3559-15D

This appendix seeks to promote greater understanding of any observations, exceptions, special instructions, or circumstances that the laboratory needs to communicate to the client concerning the above samples. The information below is used to help promote your ability to make the most informed decisions for you and your customers. Please note the following points of contact for any questions you may have.

iATL Customer Service: customerservice@iatl.com

iATL Office Manager: ?wchampion@iatl.com

iATL Account Representative: House Account

Sample Login Notes: See Batch Sheet Attached

Sample Matrix: Water

Exceptions Noted: See Following Pages

### General Terms, Warrants, Limits, Qualifiers:

General information about iATL capabilities and client/laboratory relationships and responsibilities are spelled out in iATL policies that are listed at [www.iATL.com](http://www.iATL.com) and in our Quality Assurance Manual per ISO 17025 standard requirements. The information therein is a representation of iATL definitions and policies for turnaround times, sample submittal, collection media, blank definitions, quantification issues and limit of detection, analytical methods and procedures, sub-contracting policies, results reporting options, fees, terms, and discounts, confidentiality, sample archival and disposal, and data interpretation.

iATL warrants the test results to be of a precision normal for the type and methodology employed for each sample submitted. iATL disclaims any other warrants, expressed or implied, including warranty of fitness for a particular purpose and warranty of merchantability. iATL accepts no legal responsibility for the purpose for which the client uses test results. Any analytical work performed must be governed by our Standard Terms and Conditions. Prices, methods and detection limits may be changed without notification. Please contact your Customer Service Representative for the most current information.

This confidential report relates only to those item(s) tested and does not represent an endorsement by NIST-NVLAP, AIHA LAP LLC, or any agency of local, state or province governments nor of any agency of the U.S. government.

This report shall not be reproduced except in full, without written approval of the laboratory.

### Information Pertinent to this Report:

Analysis by AAS Graphite Furnace:

- ASTM D3559-15D

Certification:

- NYS-DOH No. 11021

- NJDEP No. 03863

### Note: These methods are analytically equivalent to iATL's accredited method;

- USEPA 40CFR 141.11B

- USEPA 200.9 Pb, AAS-GF, RL <2 ppb/sample

- USEPA SW 846-7421 - Pb(AAS-GF, RL <2 ppb/sample)

Regulatory limit for lead in drinking water is 15.0 parts per billion as cited in EPA 40 CFR 141.11 National Primary Drinking Water Regulations, Subpart B: Maximum contaminant levels for inorganic chemicals.

All results are based on the samples as received at the lab. iATL assumes that appropriate sampling methods have been used and that the data upon which these results are based have been accurately supplied by the client.

Sample results are not corrected for contamination by field or analytical blanks.

PPB = Parts per billion. 1 µg/L = 1 ppb MDL = 0.24 PPB Reporting Limit (RL) = 1.0 PPB

---

CERTIFICATE OF ANALYSIS

---

Client: Partner Engineering and Science  
929 Asbury Ave  
Asbury Park NJ 07712

Report Date: 3/18/2025  
Report No.: 710484 - Lead Water  
Project: Jackson LIDW 2024; Christa McAuliffe  
Middle  
Project No.: 24-447445.1

Client: PAR929

**Disclaimers / Qualifiers:**

There may be some samples in this project that have a "NOTE:" associated with a sample result. We use added disclaimers or qualifiers to inform the client about something that requires further explanation. Here is a complete list with highlighted disclaimers pertinent to this project. For a full explanation of these and other disclaimers, please inquire at [customerservice@iatl.com](mailto:customerservice@iatl.com).

Matrix spiking is performed on each client batch to determine if interferences could impact results. When spike recoveries fall out of acceptable range matrix interference is suspected and samples are diluted until acceptable spike recovery can be achieved. Reporting limits will increase by the same degree as the dilution required.

Note: Sample dilution required due to matrix interference.

Water Sample Turbidity greater than 1.0 NTU does not meet Federal and NJ State Primary & Secondary Drinking Water Standards.

\* ASTM D3559 (D) calls for the addition of acid at the time of sampling. Unless so noted on the chain of custody by the client iATL acidifies samples to a pH of <2 at least 24 hours prior to analysis.



## Chain of Custody

### Contact Information

**Client Company:** Partner Engineering and Science,  
**Office Address:** 929 Asbury Avenue  
**City, State, Zip:** Asbury Park, NJ 07712  
**Fax Number:**  
**Email Address:** arosaperez@partneresi.com

**Project Number:** 24-447445.1  
**Project Name:** Jackson CDW 2024  
**Primary Contact:** Angelica Rosaperez  
**Office Phone:**  
**Cell Phone:** 732-403-5869

### Matrix:

Air ☐ Soil ☐ Bulk ☐ Other ☐  
Water ☒ Paint ☐ Surface Dust / Wipe ☐

### Analysis Method:

☐ PCM: NIOSH 7400  
☐ PCM: OSHA  
☐ PCM: TWA  
  
☐ Total Dust: NIOSH 0500  
☐ Total Dust: NIOSH 0600

#### PLM Use Bulk Asbestos Sample Log

☐ PLM: Bulk Asbestos EPA 600  
☐ PLM: Point Counting 198.1  
☐ PLM: NOB via 198.6 (PLM only)  
☐ If <1% by PLM, to TEM via 198.4

#### IAQ Use Mold Sample Log

☐ IAQ: I Bioaerosol Fungal Spore Trap  
☐ IAQ: II Bioaerosol Fungal Spore  
☐ IAQ: Tape, Bulk, Misc. Qualitative  
☐ IAQ: Tape, Bulk, Misc. Quantitative  
☐ IAQ: Other Culturable ID<sub>2</sub>

☐ TEM: AHERA  
☐ TEM: NIOSH 7402  
☐ TEM: ISO 10312  
☐ TEM: ISO 13794  
☐ TEM: Wipe ASTM 6480  
☐ TEM: Microvac ASTM D5755  
☐ TEM: Microvac ASTM D5756  
☐ TEM: NOB 198.4  
☐ TEM: Bulk Analysis  
☐ TEM: Potable Water  
☐ TEM: Non-Potable Water  
☐ TEM: Other  
☐ Soil: Call for Available Methods

☐ AAS: Lead in Air  
☒ AAS: Lead in Water  
☐ AAS: Lead in Paint  
☐ AAS: Lead Dust/Wipe  
☐ AAS: Lead in Soil  
☐ AAS: TCLP  
☐ AAS: Metals [Cd, Zn, Cr-circle]

1- Requires ASTM acceptable material 2- Call to confirm TAT 3- Non-culturable 4- With Non-fungal Microscopic Exam

### Special Instructions: Method 200.9

Please HOLD all Flush samples (F). If the initial sample is above 15 ppb, please run the flush sample.

### Turnaround Time

Preliminary Results Requested Date: \_\_\_\_\_ ☐ Verbal ☒ Email ☐ Fax

Specific date / time  
☒ 10 Day ☐ 5 Day ☐ 3 Day ☐ 2 Day ☐ 1 Day\* ☐ 12 Hour\*\* ☐ 6 Hour\*\* ☐ RUSH\*\*

\* End of next business day unless otherwise specified. \*\* Matrix Dependent. \*\*\*Please notify the lab before shipping\*\*\*

### Shipping Method

☐ FedEx ☐ UPS ☐ USPS ☐ Other

### Chain of Custody

Relinquished (Name/Organization): Partner Engineering and Science  
Received (Name / iATL): [Signature]  
Sample Login (Name / iATL): [Signature]  
Analyst (Name(s) / iATL): Rec. H2  
QA/QC Review (Name / iATL): Ret. H2  
Archived / Released: QA/QC InterLAB Use:

Date: 3/8/2025  
Date: 3-8-25  
Date: 3/3  
Date: 3/3

Time: 2:55  
Time: 2:55  
Time: 2:55  
Time: 2:55

## Sample Log

—Environmental Lead—

Client: JACKSON BOE Project: Christa McAuliffe Middle

Sampling Date/Time: 3/1/2015

Client Sample #	IATL #	Location/ Description	Flow Rate	Start End	Sampling time (min)	Area (ft <sup>2</sup> ) Volume (L)	Results ( )
CM-S-01	7826613	Mechanical Room		11:33		250 mL	
CM-S-01F	7826614	Mechanical room ↑		11:33			
WF-02	7826615	Adjacent Rm 125		11:35			
WF-02F	7826616			11:36			
WF-03	7826617			11:41			
WF-03F	7826618			11:41			
WF-04	7826619			11:42			
WF-04F	7826620	↓		11:43			
S-06	7826621	Faculty Rm		11:50			
S-06F	7826622	↓		11:50			
BE-14	7826623	Across Rm 111		12:11			
BE-14F	7826624	↓		12:11			
WF-08	7826625	ACROSS Rm 115		11:58			
WF-08F	7826626	↓		11:58			
↓							

\* = Insufficient Sample Provided to Perform QC Reanalysis (<200mg)

\*\* = Insufficient Sample Provided to Analyze (<50mg) \*\*\* = Matrix / Substrate Interference Possible

FB = Method Requires the submittal of blank(s). ML = Multi Layered Sample. May result in inconsistent results.

These preliminary results are issued by IATL to expedite procedures by clients based upon the above data. IATL assumes that all of the sampling methods and data upon which these results are based, has been accurately supplied by the client. These results may not have been reviewed by the Laboratory Director. Final Certificate of Analysis will follow these preliminary results. The signed COA is to be considered the official results. All EPA, HUD, and NIDDP conditions apply.

## Sample Log

—Environmental Lead—

Client: JACKSON BOE

Project: Christa McAvoy Middle

Sampling Date/Time: 3/1/25

Client Sample #	iATL #	Location/Description	Filter Ret	Start End	Sampling time (min)	Area (ft2) Volume (L)	Results ( )
CM-WF-09	7826627	Across Rm 115	3/1	12:00		250 mL	
WF-09F	7826628			12:01			
WF-10	7826629			12:02			
WF-10F	7826630			12:02			
<del>WF-11</del>				<del>12:03</del>			
<del>WF-11F</del>				<del>12:03</del>			
<del>WF-12</del>				<del>12:03</del>			
<del>WF-12F</del>				<del>12:03</del>			
WF-13	7826631	Across Rm 111		12:03			
WF-13F	7826632			12:03			
WF-14	7826633			12:08			
WF-14F	7826634			12:08			
WF-15	7826635			12:11			
WF-15F	7826636			12:12			

\* = Insufficient Sample Provided to Perform QC Reanalysis (<200mg)

\*\* = Insufficient Sample Provided to Analyze (<50mg) \*\*\* = Matrix / Substrate Interference Possible

FB = Method Requires the submittal of blank(s). ME = Multi Layered Sample. May result in inconsistent results.

These preliminary results are issued by iATL to expedite procedures by clients based upon the above data. iATL assumes that all of the sampling methods and data upon which these results are based, has been accurately supplied by the client. These results may not have been reviewed by the Laboratory Director. Final Certificate of Analysis will follow these preliminary results. The signed COA is to be considered the official results. All EPA, HUD, and NJDEP conditions apply.

## Sample Log

—Environmental Lead—

Client: Jackson BOE

Project: Christa McAniff, Michele

Sampling Date/Time: 3/1/25

Client Sample #	iATL #	Location/ Description	Flow Rate	Start End	Sampling time (min)	Area (ft <sup>2</sup> ) Volume (L)	Results ( )
CM-WF-14	7826637	ACROSS Rm 111	3/1	12:15		250 mL	
WF-16F	7826638			12:15			
WF-17	7826639			12:25			
WF-17F	7826640			12:25			
WF-18	7826641			12:26			
WF-18F	7826642			12:26			
WF-19	7826643	Adjacent Rm 129		12:34			
WF-19F	7826644			12:34			
BF-20	7826645	Adjacent Rm 129		12:36			
BF-20F	7826646			12:36			
WF-21	7826647			12:37			
WF-21F	7826648			12:38			
S-22	7826649	Room 127		12:47			
S-22F	7826650	Room 127		12:47			

\* = Insufficient Sample Provided to Perform QC Reanalysis (<200mg)

\*\* = Insufficient Sample Provided to Analyze (<30mg) \*\*\* = Matrix / Substrate Interference Possible

FB = Method Requires the submittal of blank(s). ML = Multi Layered Sample. May result in inconsistent results.

These preliminary results are issued by iATL to expedite procedures by clients based upon the above data. iATL assumes that all of the sampling methods and data upon which these results are based, has been accurately supplied by the client. These results may not have been reviewed by the Laboratory Director. Final Certificate of Analysis will follow these preliminary results. The signed COA is to be considered the official results. All EPA, HUD, and NJDEP conditions apply.

\*both labeled S-22

## Sample Log

— Environmental Lead —

Client: Jackson BOE

Project: Christa McAuliffe Middle

Sampling Date/Time: 3/1/29

Client Sample #	IATL #	Location/ Description	Flow Rate	Start End	Sampling time (min)	Area (ft <sup>2</sup> ) Volume (L)	Results ( )
CM-S-23	7826651	Room 127	3/1	12:49		250 mL	
S-23F	7826652			12:50			
S-24	7826653			12:50			
S-24F	7826654			12:51			
S-25	7826655			12:51			
S-25F	7826656			12:51			
S-26	7826657			12:52			
S-26F	7826658			12:52			
S-27	7826659			12:52			
S-27F	7826660			12:53			
S-28	7826661			12:53			
S-28F	7826662			12:53			
WF-29	7826663	Adjacent Noise		1:06			
WF-29F	7826664			1:07			
✓						✓	

\* - Insufficient Sample Provided to Perform GC Reanalysis (<200mg)

\*\* - Insufficient Sample Provided to Analyze (<50mg) \*\*\* = Matrix / Substrate Interference Possible

FB - Method Requires the submittal of blank(s). ML = Multi Layered Sample. May result in inconsistent results.

These preliminary results are issued by IATL to expedite procedures by clients based upon the above data. IATL assumes that all of the sampling methods and data upon which these results are based, has been accurately supplied by the client. These results may not have been reviewed by the Laboratory Director. Final Certificate of Analysis will follow these preliminary results. The signed COA is to be considered the official results. All EPA, HUD, and NIDEP conditions apply.



## Sample Log

—Environmental Lead—

Client: JACKSON BOE

Project: Christa McAuliffe middle

Sampling Date/Time: 3/1/25

Client Sample #	IATL #	Location/ Description	Flow Rate	Start End	Sampling Time (min)	Area (ft <sup>2</sup> ) Volume (L)	Results ( )
CM-BF-30	7826665	Adjacent nurse	3/1	1:08		250 mL	
CM-BF-30 F	7826666	↓		1:08			
		↓					
D-32	7826667	Nurse office		1:10			
S-32 F	7826668	↓		1:10			
S-33	7826669	Between Rm 214 & 215		1:17			
S-33 F	7826670	↓		1:17			
		Across Rm 214		1:21			
		↓		1:24			
WF-35	7826671			1:30			
WF-35 F	7826672	↓		1:30			
WF-36	7826673			1:35			
WF-36 F	7826674	↓		1:35			
✓		✓				✓	

\* = Insufficient Sample Provided to Perform QC Reanalysis (<200mg)

\*\* = Insufficient Sample Provided to Analyze (<50mg) \*\*\* = Matrix / Substrate Interference Possible

FB = Method Requires the submission of blank(s). ML = Multi Layered Sample. May result in inconsistent results.

These preliminary results are issued by IATL to expedite procedures by clients based upon the above data. IATL assumes that all of the sampling methods and data upon which these results are based, has been accurately supplied by the client. These results may not have been reviewed by the Laboratory Director. Final Certificate of Analysis will follow these preliminary results. The signed COA is to be considered the official results. All EPA, HUD, and NIDEP conditions apply.

## Sample Log

—Environmental Lead—

Client: JACKSON BOE Project: Christa McAffee Middle

Sampling Date/Time: 3/1/2015

Client Sample #	iATL #	Location/ Description	Flow Rate	Start End	Sampling time (min)	Area (ft <sup>2</sup> ) Volume (L)	Results ( )
QMF-37	7826675	Across Rm 214-A	3/1	1:38		250 mL	
WF-37F	7826676			1:28			
BF-38	7826677			1:38			
BF-38F	7826678			1:39			
WF-40	7826679	ACROSS 209		1:52			
WF-40F	7826680	ACROSS 209		1:52			
S-39	7826681	Rm 214-A		1:45			
S-39F	7826682	Rm 214-A		1:45			
X		ACROSS Rm 209					
X							
X							
X							
WF-43	7826683			1:56			
WF-43F	7826684			1:56			
✓		✓				✓	

\* = Insufficient Sample Provided to Perform QC Reanalysis (<200mg)

\*\* = Insufficient Sample Provided to Analyze (<50mg) \*\*\* = Matrix / Substrate Interference Possible

FB = Method Requires the submittal of blank(s). ML = Multi Layered Sample. May result in inconsistent results.

These preliminary results are issued by iATL to expedite procedures by clients based upon the above data. iATL assumes that all of the sampling methods and data upon which these results are based, has been accurately supplied by the client. These results may not have been reviewed by the Laboratory Director. Final Certificate of Analysis will follow these preliminary results. The signed COA is to be considered the official results. All EPA, HUD, and NIDEP conditions apply.

## Sample Log

— Environmental Lead —

Client: Jackson BOE Project: Christa McCalliffe middle

Sampling Date/Time: 3/1/25

Client Sample #	IATL #	Location/ Description	Flow Rate	Start End	Sampling time (min)	Area (ft <sup>2</sup> ) Volume (L)	Results ( )
CM- <del>S-44</del>	7826685	Room 209	3/1	2:03		250 mL	
- <del>S-44F</del>	7826686			2:03			
<del>W-45</del>							
<del>W-45F</del>							
<del>S-46</del>		Room 209					
<del>S-46F</del>							
S-47	7826687	Faculty lounge		2:10			
S-47F	7826688	↓		2:10			
W-48	7826689	Pafeteria Hall		2:20			
W-48F	7826690			2:20			
W-49	7826691			2:22			
W-49F	7826692			2:22			
BF-50	7826693			2:23			
BF-50F	7826694			2:24			
✓		✓	✓			✓	

\* = Insufficient Sample Provided to Perform QC Reanalysis (<200mg)

\*\* = Insufficient Sample Provided to Analyze (<50mg) \*\*\* = Matrix / Substrate Interference Possible

FB = Method Requires the submittal of blank(s). ML = Multi Layered Sample. May result in inconsistent results.

These preliminary results are issued by IATL to expedite procedures by clients based upon the above data. IATL assumes that all of the sampling methods and data upon which these results are based, has been accurately supplied by the client. These results may not have been reviewed by the Laboratory Director. Final Certificate of Analysis will follow these preliminary results. The signed COA is to be considered the official results. All EPA, HUD, and NJDEP conditions apply.

## Sample Log

—Environmental Lead—

Client: Jackson BOE

Project: Christa McAuliffe middle

Sampling Date/Time: 3/1/25

Client Sample #	iATL #	Location/ Description	Flow Rate	Start End	Sampling time (min)	Area (ft <sup>2</sup> ) Volume (L)	Results ( )
CM-WF-S1	7826695	Cafeteria Hall	2/1	2:28		250 mL	
WF-S1F	7826696	↓		2:28			
WF-S2	7826697	↓		2:29			
WF-S2F	7826698	↓		2:29			
S-53	7826699	Cafeteria		2:42			
S-53F	7826700			2:42			
S-54	7826701			2:43			
S-54F	7826702			2:43			
S-55	7826703			2:44			
S-55F	7826704			2:44			
S-56	7826705			2:45			
S-56F	7826706			2:45			
IM-57	7826707			2:45			
IM-57F	7826708			2:45			

\* = Insufficient Sample Provided to Perform QC Reanalysis (<200mg)

\*\* = Insufficient Sample Provided to Analyze (<50mg) \*\*\* = Matrix / Substrate Interference Possible

FB = Method Requires the submittal of blank(s). ML = Multi Layered Sample. May result in inconsistent results.

These preliminary results are issued by iATL to expedite procedures by clients based upon the above data. iATL assumes that all of the sampling methods and data upon which these results are based, has been accurately supplied by the client. These results may not have been reviewed by the Laboratory Director. Final Certificate of Analysis will follow these preliminary results. The signed COA is to be considered the official results. All EPA, HUD, and NJDEP conditions apply.

## Sample Log

—Environmental Lead—

Client: Jackson BGE Project: Christa McAuliffe Middle

Sampling Date/Time: 3/1/25

Client Sample #	iATL #	Location/ Description	Flow Rate	Start End	Sampling time (min)	Area (ft <sup>2</sup> ) Volume (L)	Results (...)
<del>EDM-58</del>		Gym	3/1	<del>11:41</del>		250 mL	
<del>MA-58P</del>				<del>11:42</del>			
RM-59	7826709	Gym		3:03			
WF-59F	7826710			3:03			
WF-60	7826711			3:04			
WF-60F	7826712			3:04			
WF-61	7826713			3:07			
WF-61F	7826714			3:07			
WF-62	7826715			3:08			
WF-62F	7826716			3:08			
WF-63	7826717			3:09			
WF-63F	7826718			3:09			
BF-05	7826719	RM-925		11:45			
BY-05 F	7826720	↓		11:45			
↓							↓

\* - Insufficient Sample Provided to Perform QC Reanalysis (<200mg)

\*\* - Insufficient Sample Provided to Analyze (<50mg) \*\*\* = Matrix / Substrate Interference Possible

FB = Method Requires the submittal of blank(s). ML = Multi Layered Sample, May result in inconsistent results.

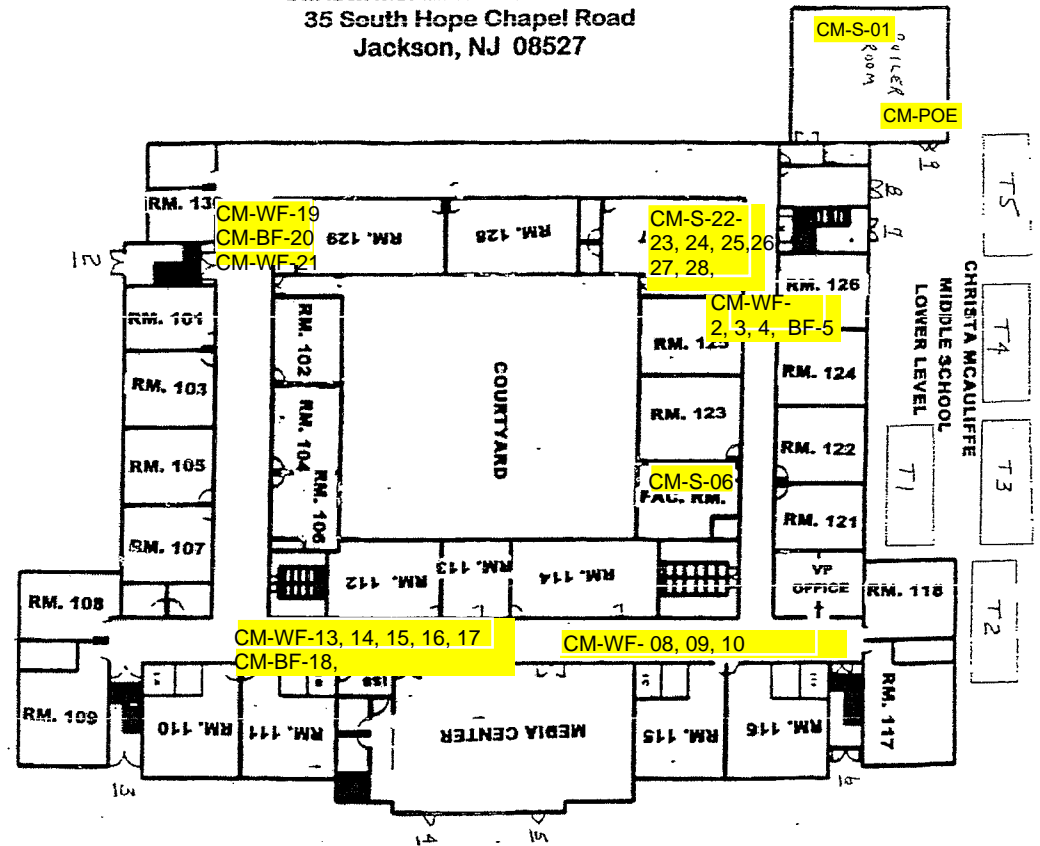
These preliminary results are issued by iATL to expedite procedures by clients based upon the above data. iATL assumes that all of the sampling methods and data upon which these results are based, has been accurately supplied by the client. These results may not have been reviewed by the Laboratory Director. Final Certificate of Analysis will follow these preliminary results. The signed COA is to be considered the official results. All EPA, HUD, and NDEP conditions apply.

## APPENDIX C: SAMPLE LOCATION DIAGRAM

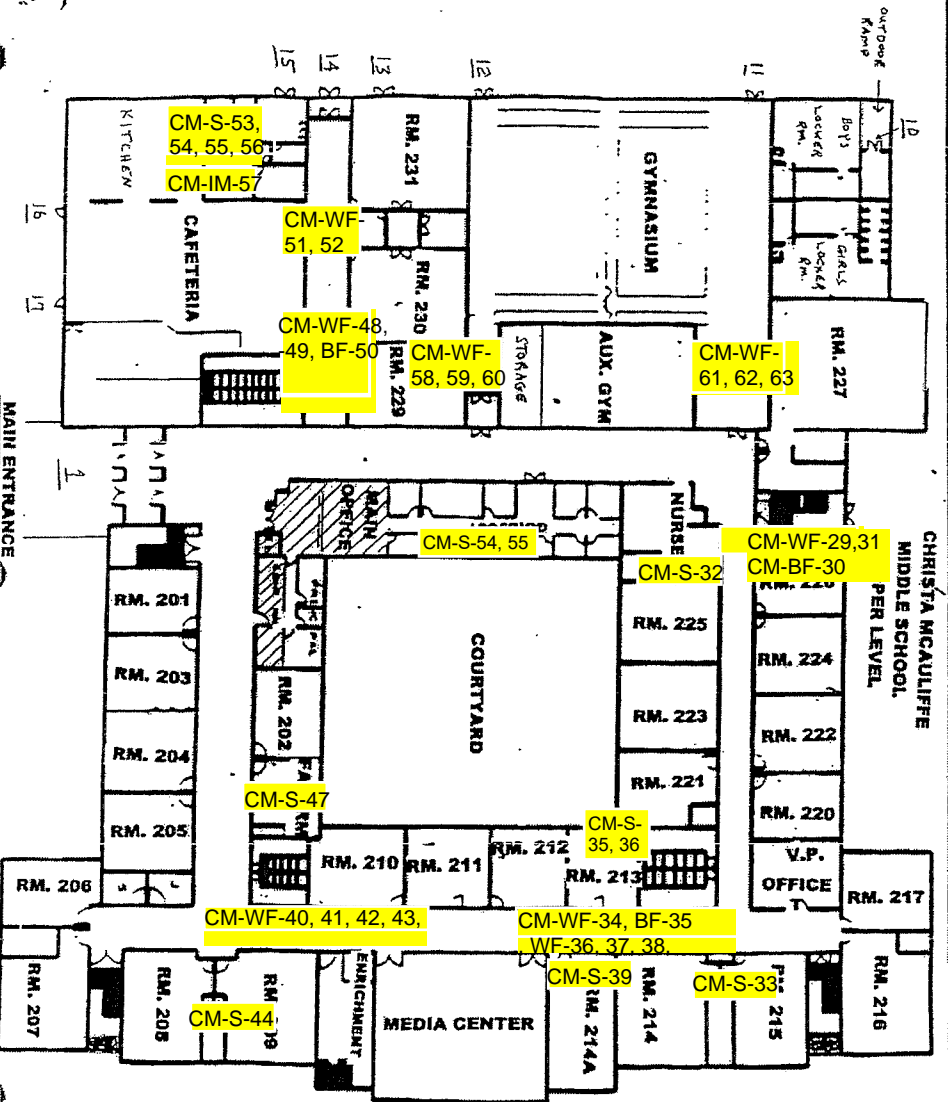
---

# CHRISTA McAULIFFE MIDDLE SCHOOL

Christa McAuliffe Middle School  
35 South Hope Chapel Road  
Jackson, NJ 08527



**B**



**A**